


AVERAGE LOSS OF WATER LEAKING  
FAUCETS OVER A PERIOD OF ONE MONTH

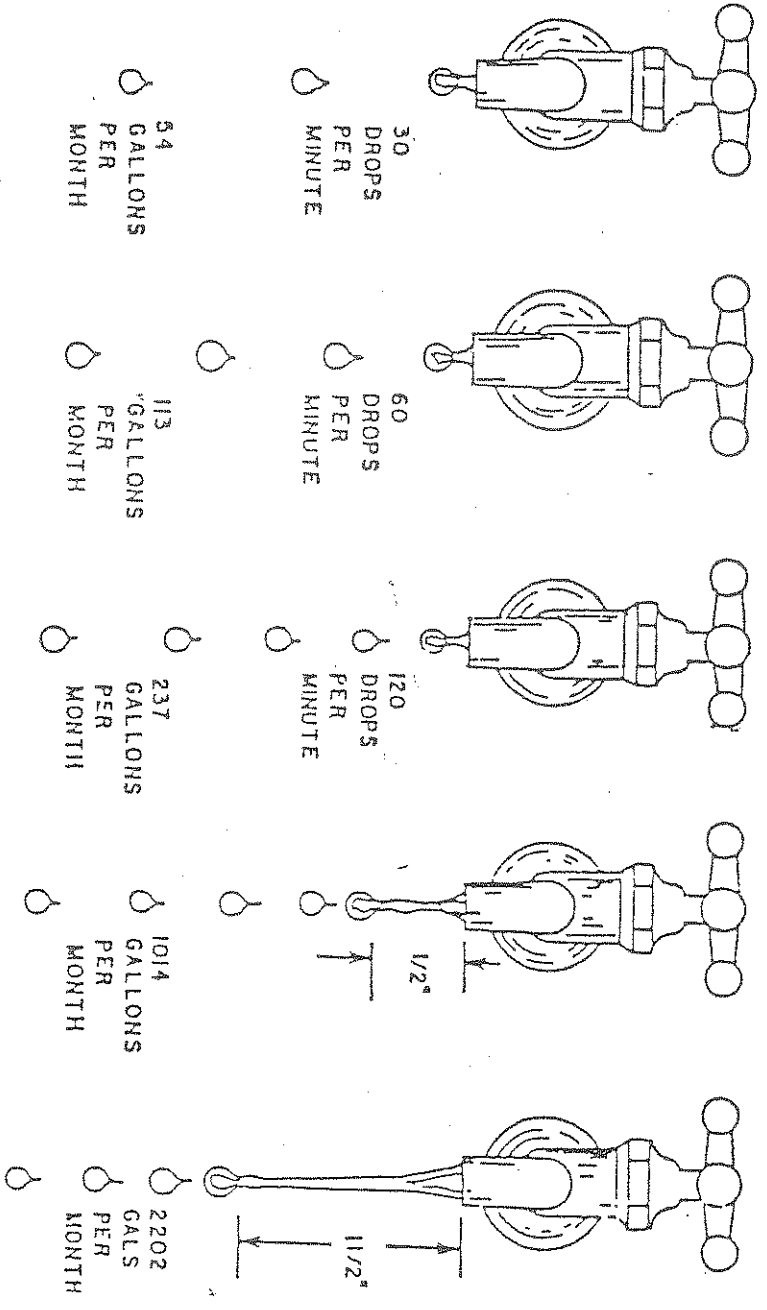

SMALL, CONTINUOUS LEAKS WILL WASTE LARGE AMOUNTS OF WATER. IN ADDITION, LEAKS IN HOT-WATER LINES WILL WASTE HEAT. KEEP ALL VALVES AND FAUCETS TIGHT. WHEN A LEAK DEVELOPS, REPLACE FAUCET WASHERS. IF VALVES OR FAUCETS ARE DAMAGED, REPLACE FAUCET OR VALVE ASSEMBLY.

● 1/16" HOLE	.56 GAL. PER MIN.	800 GAL. PER DAY	19,400 GAL. PER YEAR
● 1/8" HOLE	2.25 GAL. PER MIN.	3,240 GAL. PER DAY	1,183,000 GAL. PER YEAR
● 1/4" HOLE	9.00 GAL. PER MIN.	12,960 GAL. PER DAY	4,730,000 GAL. PER YEAR